


JOINT LUG DETAIL FOR MEDIAN PAVEMENT
OR SIDEWALK ADJACENT TO CURB

N.T.S.

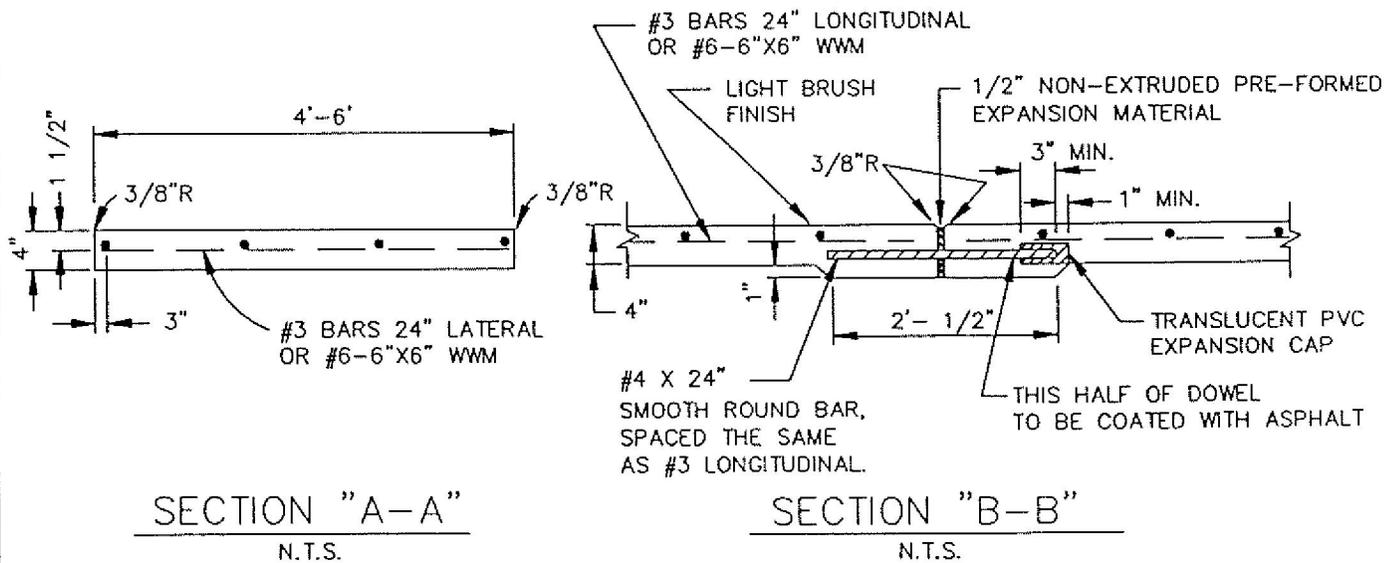

NOTE:

1. CROSS SLOPE OF SIDEWALK SHALL BE $\pm 1/4"$ PER FT. MINIMUM.
2. SIDEWALK WIDTH SHALL BE SPECIFIED BY THE CITY.
3. SIDEWALK SHALL BE CLASS "A" CONCRETE UNLESS OTHERWISE SPECIFIED BY THE CITY.
4. ALL HONEYCOMB IN BACK OF CURB TO BE TROWEL-PLASTERED BEFORE POURING SIDEWALK.
5. LUG MAY BE FORMED BY SHAPING SUBGRADE TO APPROXIMATE DIMENSIONS SHOWN.

REINFORCED CONCRETE SIDEWALKS

JOINTS AND SPACING



STANDARD SPECIFICATION REFERENCE

8.3.

DATE

JAN.'98

STANDARD DRAWING NO

GR2170A